



Architectural Testing

AAMA/WDMA/CSA 101/1 S 7/A440 09

**TEST REPORT**

**Rendered to:**

**MI WINDOWS AND DOORS, INC.**

**SERIES/MODEL: 1650**

**PRODUCT TYPE: PVC Fixed Window (Finless)**

Title	Summary of Results
Primary Product Designator	Class LC-PG35 2438 x 1520 (96 x 60)-FW
Design Pressure	±1680 Pa (±35.09 psf)
Air Infiltration	0.2 L/s/m <sup>2</sup> (0.03 cfm/ft <sup>2</sup> )
Water Penetration Resistance Test Pressure	360 Pa (8.27 psf)

**A·L·I**

**AAMA**



**MI Windows & Doors, LLC  
P.O. Box 370  
Gratz, PA 17030-0370**

**Attn: Rick Sawdey**



Architectural Testing

AAMA/WDMA/CSA 101/LS.2/A440-08 TEST REPORT

Rendered to:

MI WINDOWS AND DOORS, INC.  
P.O. Box 370  
650 West Market Street  
Gratz, Pennsylvania 17030-0370

Report No.: A0297.01-109-47

Test Date: 04/28/10

And: 04/29/10


Report Date: 05/17/10

Test Record Retention Date: 04/29/14

**Project Summary:** Architectural Testing, Inc. was contracted by MI Windows and Doors, Inc.

**Test Specimen Description: (Continued)**

**Weatherstripping:** No weatherstripping was utilized.

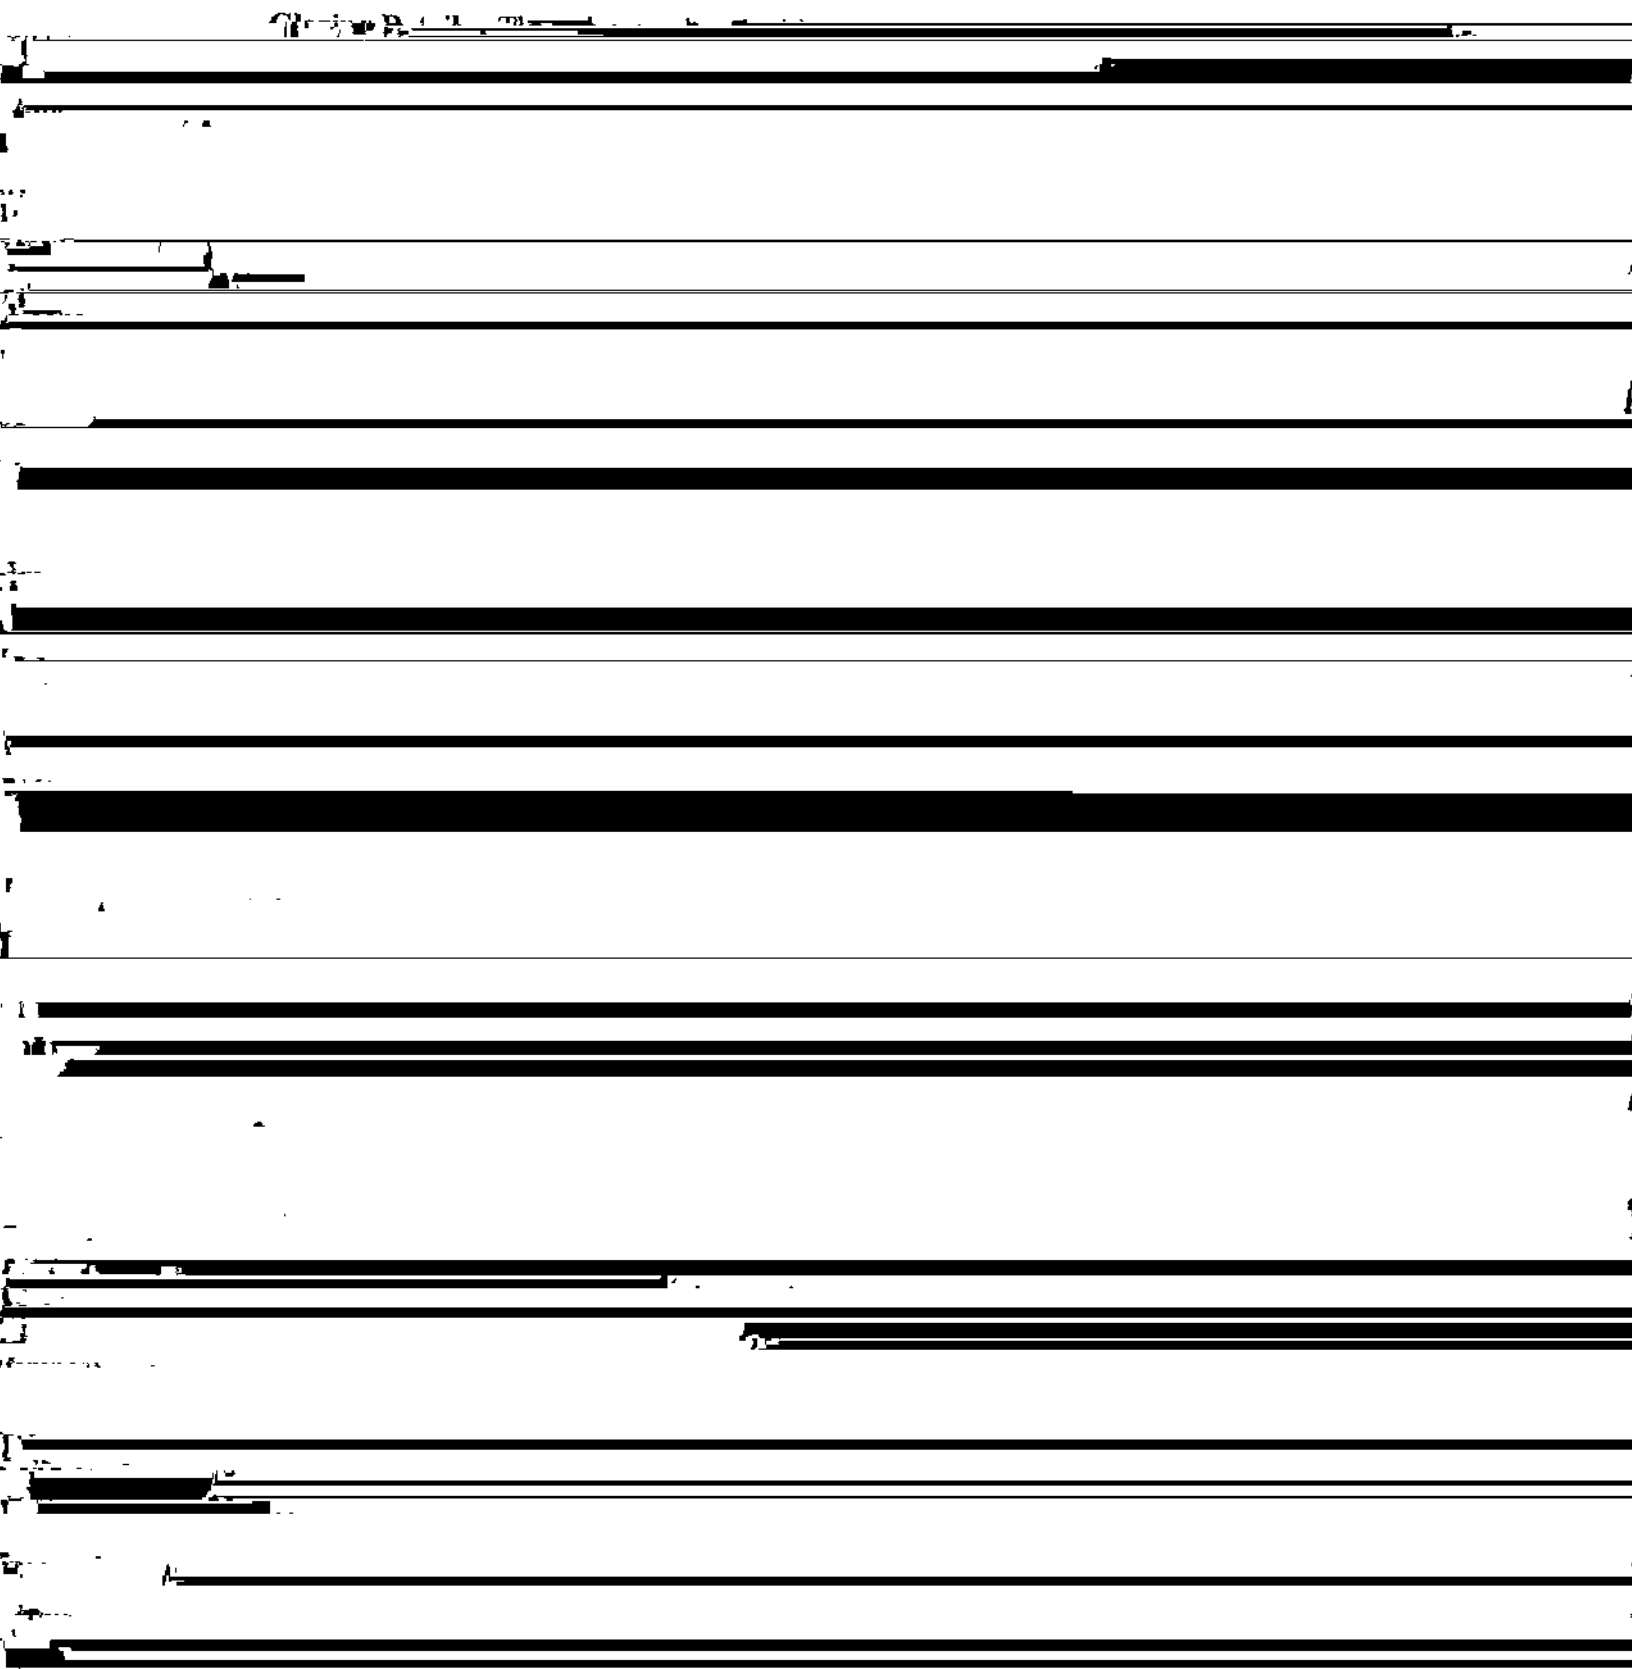

Test Results: (Continued)

<u>Paragraph</u>	<u>Title of Test - Test Method</u>	<u>Results</u>	<u>Allowed</u>
5.3.3.2	Water Penetration Resistance per ASTM E 547		See Note #2
5.3.4.2	Uniform Load Deflection per ASTM D 2000		

Tape and film were not used to seal against air leakage during structural testing.

Drawing Reference: The test specimen drawings have been reviewed by A-E-T's structural

Detailed drawings, data sheets, representative samples of test specimens, etc. shall be submitted.

### Revision Log

<u>Rev. #</u>	<u>Date</u>	<u>Page(s)</u>	<u>Revision(s)</u>
0	05/17/10	N/A	Original report issue



**Appendix A**  
**Alteration Addendum**

*Note: No alterations were required.*

**Appendix B**  
**Test Equipment**

Instrument	Manufacturer	Asset #
------------	--------------	---------

**Appendix C**

**Drawings**

*Note: Complete drawings packet on file with Architectural Testing, Inc.*